

IEC**IECEE**

®

TM

Ref. Certif. No.

CN72531

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME**CB TEST CERTIFICATE**

Product

Switch-disconnectors

Name and address of the applicant

Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Name and address of the manufacturer

Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Name and address of the factory

Yueqing Economic Development Branch of Zhejiang Tengen
Electric Co.,Ltd.*Note: When more than one factory, please report on page 2*No.288 Central Avenue, Development Zone, Yueqing City,
Zhejiang Province, P.R.China

Ratings and principal characteristics

See the Appendix

Trademark (if any)

TENGEN

Customer's Testing Facility (CTF) Stage used

N/A

Model / Type Ref.

TGW5FGDC-2500HU,TGW5FGDC-4000HU;

Additional information (if necessary may also be reported on page 2)

A sample of the product was tested and found to be in conformity with

IEC 60947-1:2020;IEC 60947-3:2020

As shown in the Test Report Ref. No. which forms part of this Certificate

03601-A-25CB0076-S

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86-10-83886666 Fax: +86-10-83886282

website: <http://www.cqc.com.cn>

Date: Jul.07,2025

Signature:

谢肇煦

Xie ZhaoXu



TGW5FGDC-2500HU TGW5FGDC-4000HU

Ui: 1600V;Uimp:15kV;

Ue:DC1500V;

Ith:4000A;

TGW5FGDC-2500HU Ie: 1600A、 2000A、 2500A;

TGW5FGDC-4000HU Ie: 1600A、 2000A、 2500A、 2900A、 3200A、 3600A、 4000A;

Icw:100kA/1s, 150kA/0.2s;

Icm(peak): 100kA;

Utilization category: DC-PV2,DC-22A,DC-23A; 2P appearance;


IP40(operative surface)

Auxiliary contact :4NO4NC:Ui: 690V;Uimp:6kV;Ith:6A;

AC-15:Ue/Ie:AC230V/1.5A、 AC400/0.9A、

DC-13:Ue/Ie:DC220V/0.27A 、 DC110V/0.55A.

DC connection method:

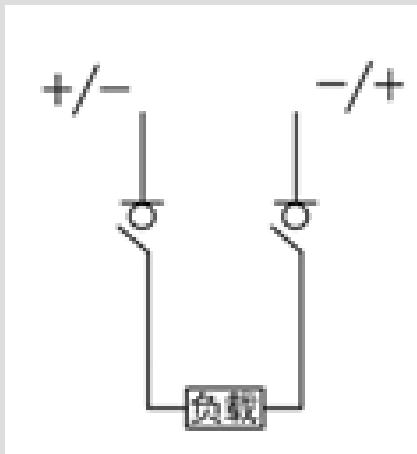

Additional information (if necessary)

Date:

Jul.07,2025

Signature:

谢肇煦

Xie ZhaoXu